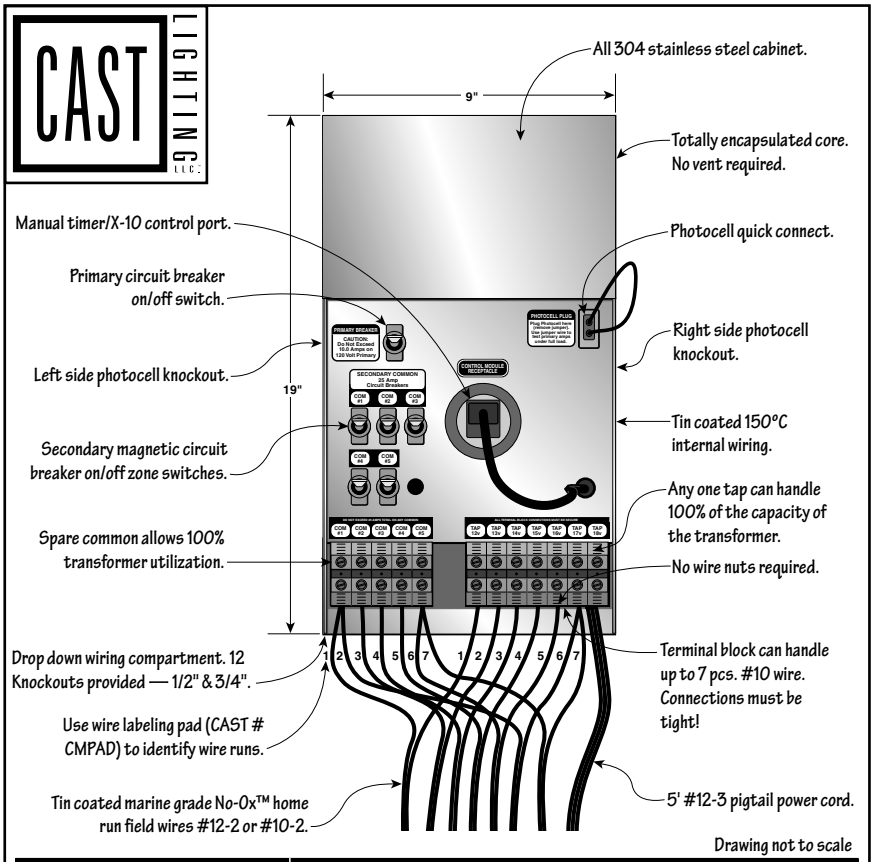


| MODEL # | Transformer Typical Installation Detail |
|---|---|
| **CM1200SSMT** | NOTES: • Make sure home run wires are tight in the terminal blocks. Loose/poor connections will melt the block and damage the transformer.<br>• Field repairable breakers, terminals, timer and photocell.<br>• For transformer sizing see CAST "Transformer and System Installation Guide".<br>• For transformer mounting information see "Transformer Stand Detail". |
| Rev. 2-28-03 — Plan Symbol: T | |

© Copyright 2003, CAST Lighting LLC. All rights reserved.
CAST Lighting LLC. 1120-A Goffle Rd. • Hawthorne, NJ 07506 • Tel: 800.914.CAST • Fax:973.423.2304 • www.cast-lighting.com